

CERTIFICATE

No: 000239/02

In accordance with the **CertAlarm** Rules and Certification scheme type 5, as defined in ISO/IEC 17067, we
Telefication B.V. certify that the product

3G9080-EU

is in conformity with the following standard(s)

EN 50131-10 June, 2014

Alarm systems - Intrusion and hold-up systems - Part 10: Application specific requirements for Supervised
Premises Transceiver (SPT)

EN 50136-2 August, 2013

Alarm systems - Alarm transmission systems and equipment - Part 2: Requirements for Supervised Premises
Transceiver (SPT)

Digital Security Controls, a div. of Tyco Safety Products Canada Ltd.

3301 Langstaff Road
L4K 4L2 CONCORD
Canada

is authorised to use the CERTALARM Mark on the above mentioned product.
This certificate is valid until:
04 December 2022

Zevenaar, 08 November 2019

Signed on behalf of Telefication B.V.



Jan Willem Verwoert
Project Manager



CERTIFICATE

No: 000239/02 - Annex No 1

Takes into account the following product and variants:

- Product description: Power Series Pro Model 3G9080-EU Cellular Alarm Communicator
- Trademark: DSC/Tyco
- Type designation: 3G9080-EU
- Hardware version: UA716 Rev. 03
- Software version: 1.0

- Product description: Cellular Alarm Communicator
- Trademark: DSC/Tyco
- Type designation: GS9080
- Hardware version: UA716 Rev. 03
- Software version: 1.0

The optional features of the specifications that are included in the product and test report:

Security grade: 3
Environmental class: II
Equipment class: Fixed
ATS class : SP4 (DP2, DP3 or DP4 when combined with LAN or PSTN)

This equipment can be applied in EN 50131-1 compliant systems up to and including security grade 3.

Applied standards:
EN 50131-1:2006 + A1:2009 + A2:2017
EN 50136-1:2012 + A1:2018
EN 50130-4:2001 + A1:2014
EN 50130-5:2011

Factory location:
Tyco International De Mexico S De R.L. De C.V.
Antonio Meucci Yg Gonzalez Camarena 10002
Parque Industrial La Ventana
87569, Matamoros
Mexico


Product inspection location:
AnB Rimex SA
Rue de l'Abbaye 89
4040, Herstal
Belgium

CERTIFICATE

No: 000239/02 - Annex No 1

Test Reports:

- Nemko Canada Inc.: HS3128_HSC3020C EN50130-4 Report 351820-2TRFEMC, 31 August 2018
- Nemko Canada Inc.: HS3128_HSC3020CP EN50130-4 Report 351713-2TRFEMC, 20 June 2018
- Nemko Canada Inc.: 3G9080-EU_HSC3020C EN50130-4 Report 351717-2TRFEMC, 22 June 2018
- Nemko Canada Inc.: 3G9080-EU_HSC3020CP EN50130-4 Report 351819-2TRFEMC, 28 June 2018
- Telefication: 180600139-001-Ver.2.00, 21 December 2018
- Telefication: 180600139-002-Ver.2.00, 21 December 2018
- Telefication: 180600139-ENV-Ver.1.00, 03 December 2018

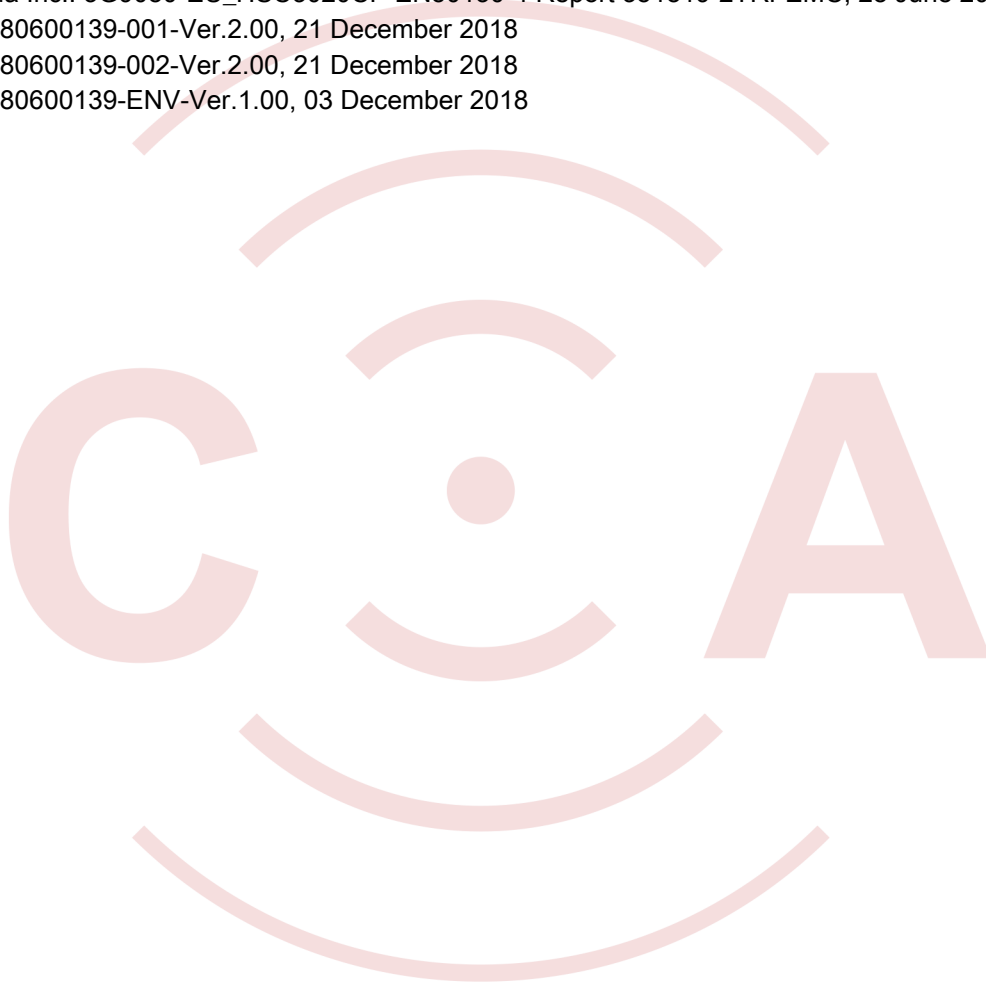

CERTIFICATE

No: 000239/02 - Annex No 2

Validity of Certificate:

The Certificate remains valid based upon satisfactory annual factory production control audits for Fire products or biennial factory production control audits for Security products and follow up re-testing as required by CertAlarm scheme rules.

Documents submitted:

- Assembly drawings
- Bill of material / Parts list
- Electronic schematics
- Manual
- Internal / external photos
- Label and label placement

DISCLAIMER:

The validity of this certificate is limited to products, which are equal to the one(s) examined.